

Uygulama Alanı Application Area	:	İklimlendirme Air Conditioning
Test/Raporlama Tarihi Test/Report Date	:	05.02.2018
Numune Tanımı Sample Description	:	PM 4030
Test Metodu Test Method	:	ASTM 1050
Raporun Sayfa Sayısı Number of pages of the report	:	3
Test Sipariş No Test Order No	:	#


Bu rapor özel test talebine istinaden düzenlenmiş olup, "Standartlara Uygunluk Belgesi" niteliğinde değildir. Partiyi temsil etmez, ayrıca ilan, reklam ve ihalelerde uygunluk belgesi niteliğinde kullanılamaz.

This test report was prepared upon customer's request, can't be used as certificate of conformity to standards, does not represent a batch and cannot be used as conformity document for advertisements and procurements.


4 –TEST SONUÇLARI / TEST RESULTS

a-) Ses İletim Kaybı / Sound Transmission Loss

Frekans / Frequency (Hz)	Sound Transmission Loss (dB)	Frekans / Frequency (Hz)	Sound Transmission Loss (dB)
63	24,45	1000	28,88
125	25,17	1250	25,09
160	26,69	1600	26,38
200	23,86	2000	31,05
250	17,73	2500	37,10
315	21,21	3150	41,89
400	22,49	4000	47,27
500	22,01	5000	54,27
630	19,36	8000	63,68
800	23,22		

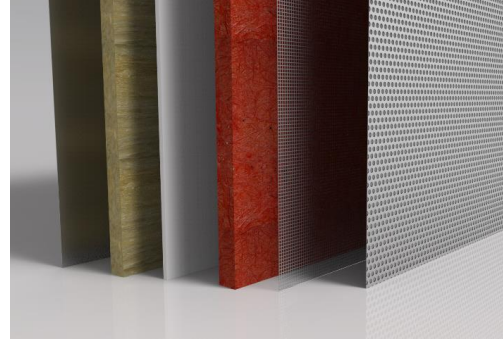


Sıcaklık (°C)	Nem (%)
25	43

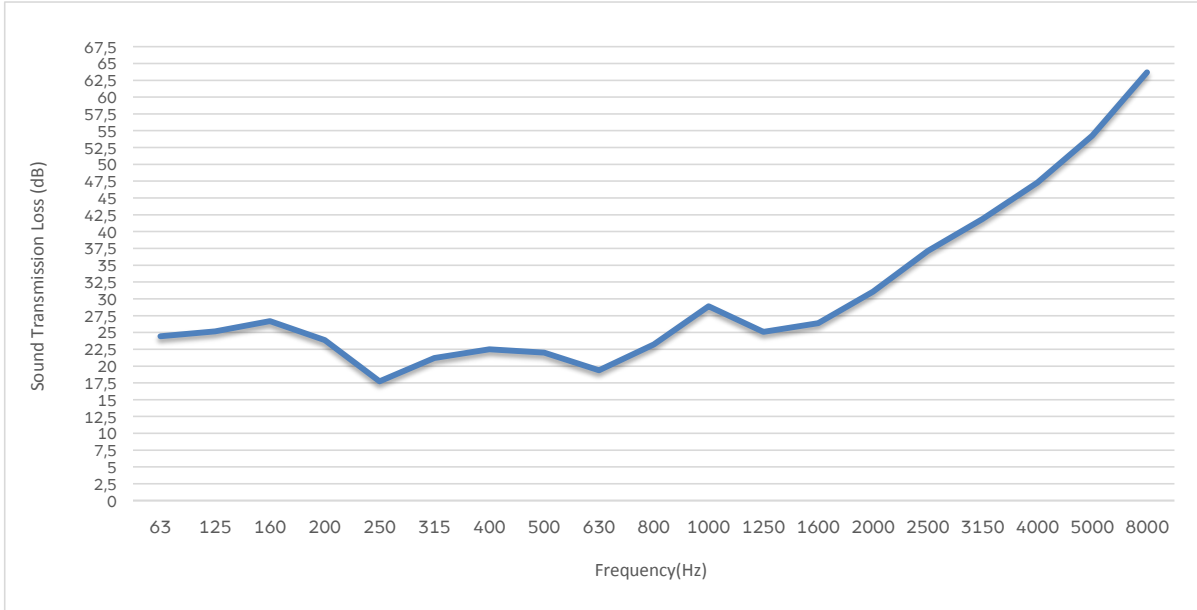

b-) Ses Yutum Katsayısı / Sound Absorption Coefficient

Frekans / Frequency (Hz)	Sound Absorption Coefficient (a)	Frekans / Frequency (Hz)	Sound Absorption Coefficient (a)
63	0,33	1000	0,94
125	0,41	1250	0,98
160	0,47	1600	1,00
200	0,54	2000	0,99
250	0,61	2500	0,98
315	0,67	3150	0,98
400	0,71	4000	0,99
500	0,74	5000	1,00
630	0,80	8000	1,00
800	0,88		

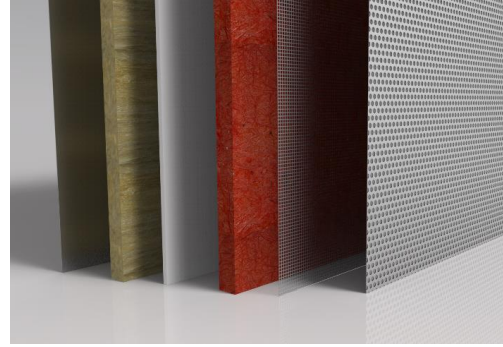

Sıcaklık (°C)	Nem (%)
25	43

