

Uygulama Alanı Application Area	:	Test ve Kontrol Odaları Test and Control Rooms
Test/Raporlama Tarihi Test/Report Date	:	05.02.2018
Numune Tanımı Sample Description	:	PM 4060
Test Metodu Test Method	:	ASTM 1050
Raporun Sayfa Sayısı Number of pages of the report	:	3
Test Sipariş No Test Order No	:	#


Bu rapor özel test talebine istinaden düzenlenmiş olup, "Standartlara Uygunluk Belgesi" niteliğinde değildir. Partiyi temsil etmez, ayrıca ilan, reklam ve ihalelerde uygunluk belgesi niteliğinde kullanılamaz.

This test report was prepared upon customer's request, can't be used as certificate of conformity to standards, does not represent a batch and cannot be used as conformity document for advertisements and procurements.


4 –TEST SONUÇLARI / TEST RESULTS

a-) Ses İletim Kaybı / Sound Transmission Loss

Frekans / Frequency (Hz)	Sound Transmission Loss (dB)	Frekans / Frequency (Hz)	Sound Transmission Loss (dB)
63	24,3	1000	30,0
125	25,2	1250	26,8
160	26,8	1600	28,2
200	24,1	2000	31,1
250	17,6	2500	37,1
315	20,7	3150	42,1
400	23,2	4000	47,5
500	23,5	5000	54,9
630	20,6	8000	60,2
800	25,2		

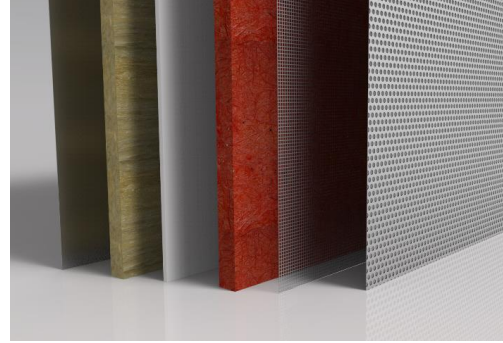


Sıcaklık (°C)	Nem (%)
25	43

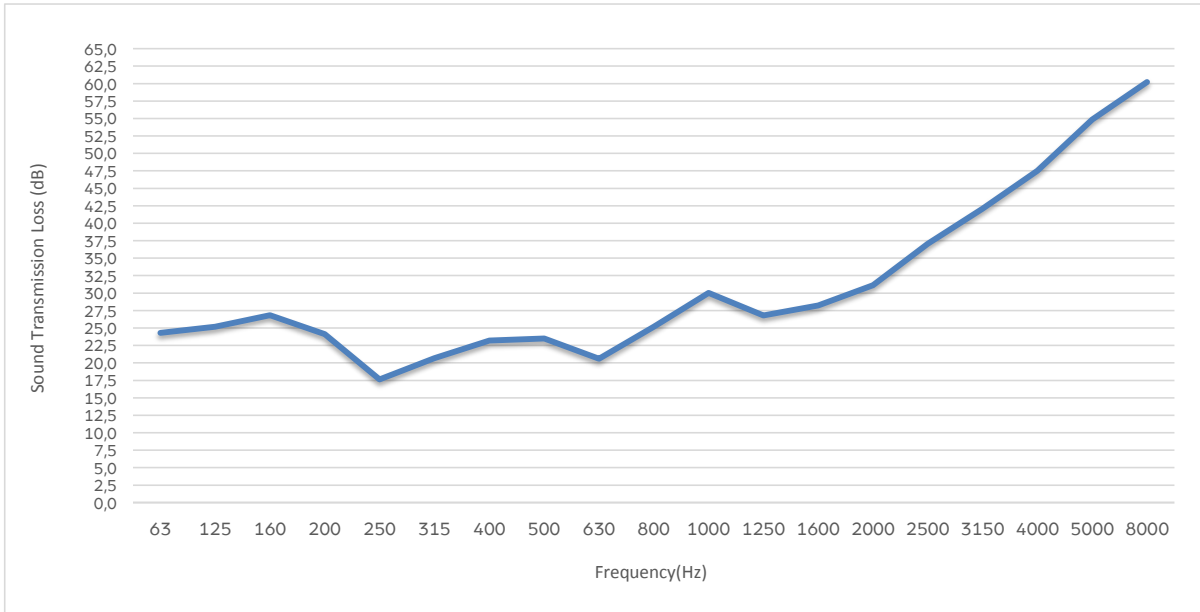

b-) Ses Yutum Katsayısı / Sound Absorption Coefficient

Frekans / Frequency (Hz)	Sound Absorption Coefficient (a)	Frekans / Frequency (Hz)	Sound Absorption Coefficient (a)
63	0,29	1000	0,90
125	0,37	1250	0,97
160	0,43	1600	0,99
200	0,49	2000	0,99
250	0,54	2500	0,98
315	0,59	3150	0,97
400	0,67	4000	0,98
500	0,75	5000	0,99
630	0,79	8000	0,99
800	0,83		

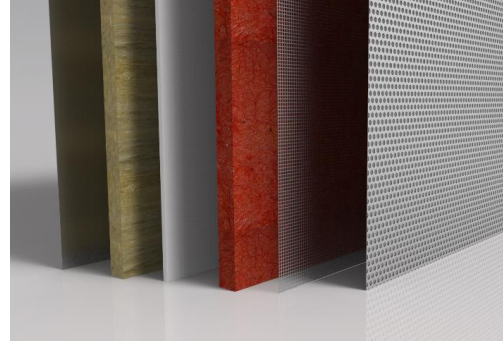

Sıcaklık (°C)	Nem (%)
25	43

